

BOLLY® 2 AP - HIGH PERFORMANCES

POLYWARM® COATED DOMESTIC HOT WATER CALORIFIER WITH 2 FIXED HEAT EXCHANGERS



APPLICATION

Production and storage of domestic hot water (DHW).
All the connections are aligned on the front and on the back for quick and easy installation.

MATERIAL

Mild steel Polywarm® coated (Attestation ACS - SSICA - EN 16421 - WRAS)

HEAT EXCHANGER

N° 2 Mild steel Polywarm® coated heat exchangers

INSULATION

- HARD: High thermal insulation with ecological polyurethane hard foam.
- HARD FOAM (CLASS "A" MODELS): rigid polyurethane foam for high thermal insulation with a vacuum sheet of highly insulating material.
Grey PVC external lining.

CATHODE PROTECTION

Magnesium anode.

DRAIN

External confluence through drain connection.

GASKET- FLANGE PLATE


Silicone gaskets suitable for water intended for human consumption (tested according to 98/83/CE), max temperature up to 200°C. Mild steel inspection flange plate with Polywarm®.

WARRANTY

5 years (See general sales conditions and warranty)


ACCESSORIES AND SPARE PARTS

See Accessories section for the entire list.

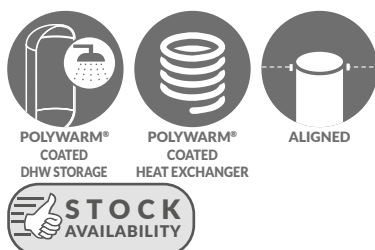

BOLLY® 2 AP WB

Model	HARD FOAM INSULATION		Upper	Lower	
	Art. Nr.		[m²]		
200	A101313 / 3134162320006	0,4	1,4	B	
300	A101314 / 3134162320007	0,9	1,4	B	
500	A101315 / 3134162320008	1,3	2,2	C	



On line ErP label tool



BOLLY® 2 AP WB CLASS A

Model	HARD FOAM INSULATION	Upper	Lower	
		[m²]		
	Art. Nr.			
200	3134162330024	0,4	1,4	A
300	3134162330025	0,9	1,4	A
500	3134162330026	1,3	2,2	A



ACCESSORIES

ELECTRIC IMMERSION HEATERS



Mod.	Position of the electric heater	Heated volume by electric immersion heater [lt]
200	1	159
	2	58
300	1	235
	2	112
500	1	413
	2	185

MONOPHASE

1,5 kW	2 kW	3 kW
5240000000051	5240000000052	5240000000053
Ignition time from 10 °C to 45 °C with electric immersion heaters [min]		
285	214	142
104	78	52
421	316	210
201	151	100
741	555	370
331	248	165

THREEPHASE

4 kW	5 kW	6 kW
5240000000047	5240000000048	5240000000049
Ignition time from 10 °C to 45 °C with electric immersion heaters [min]		
//	//	//
39	//	//
158	//	//
75	60	//
278	222	//
124	99	83

Thermometer

Art. Nr.
5032240000107
5 units box



Titanium electronic anode

Art. Nr.	Model
5200000000008	200, 300
5200000000009	500



HEAT MANAGER kit + electric resistance with probe and 3m cable

Art. Nr.	ELECTRICAL RESISTANCE
5240000000074	1,5 kW
5240000000075	2 kW
5240000000076	3 kW



See Accessories section



BOLLY®

2 AP - HIGH PERFORMANCES

POLYWARM® COATED DOMESTIC HOT WATER CALORIFIER WITH 2 FIXED HEAT EXCHANGERS

STORAGE		HEAT EXCHANGER	
Pmax	Tmax	Pmax	Tmax
10 bar	90 °C	12 bar	110 °C






CORDIVARI

Lab

TÜV Rheinland Energie und Umwelt GmbH states that test procedures and Cordivari LAB are certified conforming to European standard EN 15332, as indicated by Ecodesign ErP Directive.

TESTED

ErP

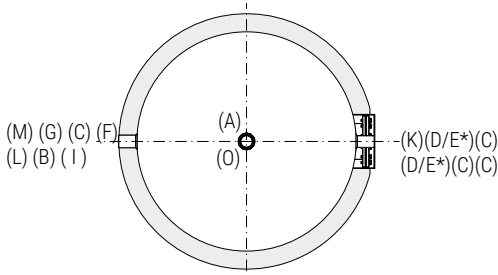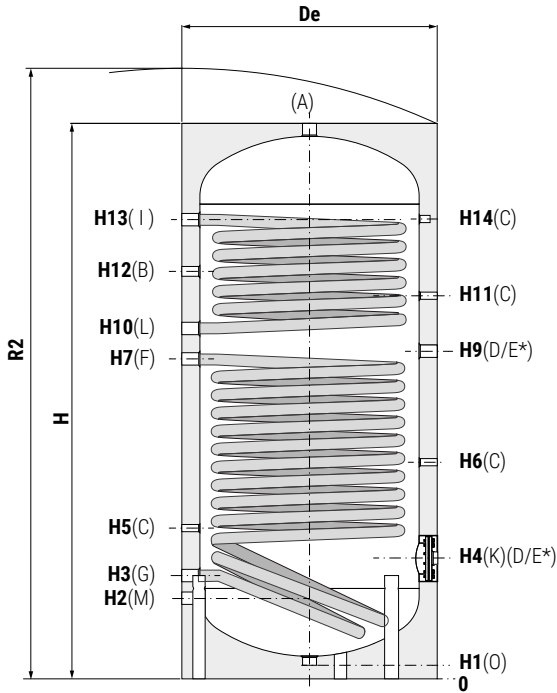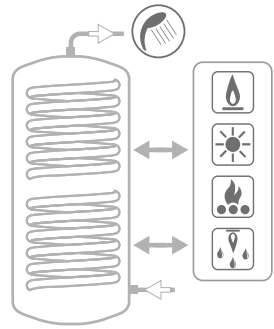

A	Domestic hot water outlet
B	Recirculation
C	Connection for instrumentation 1/2" G F
D	Connection for electric immersion heater
E*	Connection for magnesium anode Use a reduction 1"1/2 → 1"1/4
F	Lower heat exchanger inlet 1"1/4 G F
G	Lower heat exchanger outlet 1"1/4 G F
I	Upper heat exchanger inlet 1"1/4 G F
K	Flange for inspection
L	Upper heat exchanger outlet 1"1/4 G F
M	Domestic cold water circuit inlet
O	Drain 1" 1/4 F

BOLLY® 2 AP WB +AP WB CLASS A (HARD FOAM INSULATION)

Model	Volume [lt]	Weight [Kg]	De	H	H (cl. A)	R2	R2 (cl. A)	H1	H2	H3	H4	H5	H6	H7	H8	H9
200	189	65	550	1434	1434	1540	1540	71	215	285	325	405	535	925	//	970
300	291	83	650	1486	1486	1630	1630	71	241	311	381	431	561	832	//	906
500	498	134	750	1786	1836	1950	1990	71	266	346	411	466	586	1036	//	1111

Model	H10	H11	H12	H13	H14	K	O	M	D	B	A
	[mm]						Connections F				
200	1015	1080	1115	1205	1195	Øi120/Øe180	1"1/4	3/4"	1"1/2	3/4"	1"1/4
300	981	1021	1101	1221	1221	Øi120/Øe180	1"1/4	1"	1"1/2	1"	1"1/4
500	1186	1246	1331	1476	1476	Øi120/Øe180	1"1/4	1"	1"1/2	1"	1"1/4

BOLLY® 2 AP


HEAT EXCHANGERS TECHNICAL DATA



Data have been calculated on following basis:

- 1) Primary circuit at T1 and proper energy source;
- 2) Production of DHW in continuous from 10 °C to t2;
- 3) DHW that can be taken in the first 10' and in the first hour from storage at 60°C, input 10°C and output 45°C;
- 4) Sanitary water according to UNI CTI 8065.


UPPER HEAT EXCHANGER

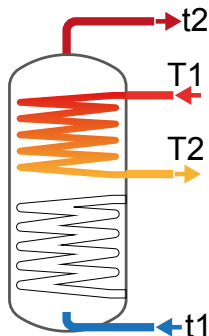

Model	Primary Flow rate [m³/h]	Ignition time (minutes) from 10 °C to t2 and primary at T1				Maximum power exchange (kW) with primary at T1, secondary within 10-45 °C and constant use of DHW production				DHW continuous production lt/h within 10-45 °C and primary at T1			
		T1/t2				T1				T1			
		55/50	65/60	70/60	80/60	55	65	70	80	55	65	70	80
200	2	54	56	39	25	4,4	6,6	7,7	10	107	162	190	247
	1	61	63	44	29	4	6	7	9	97	146	170	221
300	3	41	43	30	20	9,9	15	17,5	22,8	243	368	432	562
	1,5	47	48	34	22	9,1	13,6	15,8	20,4	223	333	389	503
500	3,5	49	51	35	23	14,4	22,5	25,9	32,8	353	532	623	809
	1,75	55	57	40	26	13,3	19,6	22,8	29,3	326	482	562	724

Model	Primary Flow rate [m³/h]	DHW produced in the first 10 minutes in lt/10' input 10 °C output 45 °C, storage at t2 and primary at T1				DHW produced in the first hour in lt/60' input 10 °C output 45 °C, storage at t2 and primary at T1				Heat exchanger pressure drop	
		T1/t2				T1/t2				[mm.c.a.]	[mbar]
		55/50	65/60	70/60	80/60	55/50	65/60	70/60	80/60		
200	2	234	297	302	311	302	400	422	468	150	15
	1	232	294	298	307	294	387	406	447	50	5
300	3	149	197	208	229	303	430	481	585	194,65	19,09
	1,5	146	191	201	220	287	402	447	538	53,92	5,29
500	3,5	242	317	332	363	465	654	727	876	316,51	31,04
	1,75	237	309	322	349	444	614	678	808	87,68	8,60


LOWER HEAT EXCHANGER

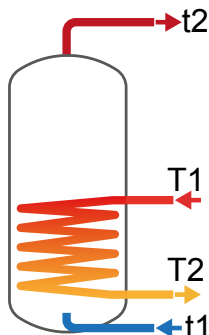

Model	Primary Flow rate [m³/h]	Ignition time (minutes) from 10 °C to t2 and primary at T1				Maximum power exchange (kW) with primary at T1, secondary within 10-45 °C and constant use of DHW production				DHW continuous production lt/h within 10-45 °C and primary at T1			
		T1/t2				T1				T1			
		55/50	65/60	70/60	80/60	55	65	70	80	55	65	70	80
200	3	54	56	40	26	16	23	27	36	384	576	673	871
	1,5	62	65	46	31	15	21	25	32	354	522	607	778
300	3	82	85	60	39	15,6	23,4	27,3	36,3	384	576	673	871
	1,5	94	98	69	45	14,6	21,2	24,6	31,6	354	522	607	778
500	3,5	100	104	73	48	22,3	33,2	38,7	49,9	549	820	956	1234
	1,75	115	120	85	56	20,6	30	34,7	44,3	506	741	858	1095


Model	Primary Flow rate [m³/h]	DHW produced in the first 10 minutes in lt/10' input 10 °C output 45 °C, storage at t2 and primary at T1				DHW produced in the first hour in lt/60' input 10 °C output 45 °C, storage at t2 and primary at T1				Heat exchanger pressure drop	
		T1/t2				T1/t2				[mm.c.a.]	[mbar]
		55/50	65/60	70/60	80/60	55/50	65/60	70/60	80/60		
200	3	280	366	382	415	523	731	808	967	830	81
	1,5	275	357	371	400	499	688	756	892	243	24
300	3	397	512	528	561	640	877	954	1113	1082,03	106,11
	1,5	392	503	517	545	616	833	901	1038	299,73	29,39
500	3,5	660	847	869	916	1007	1366	1475	1697	2056,48	201,67
	1,75	652	834	853	893	973	1303	1396	1586	569,66	55,86

HEAT EXCHANGERS PRESSURE DROP

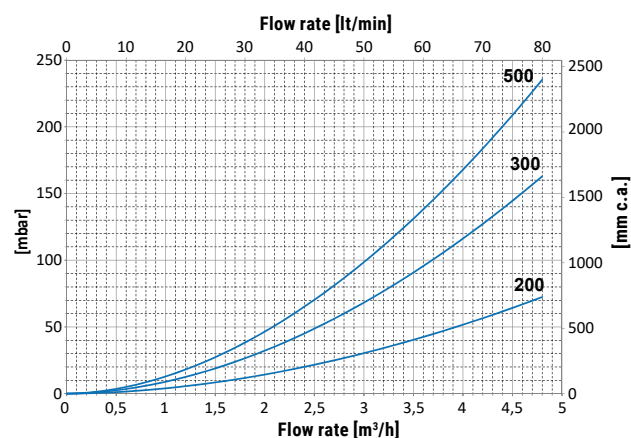

UPPER

Heat exchangers surface [m²]	
200	0,4
300	0,9
500	1,3

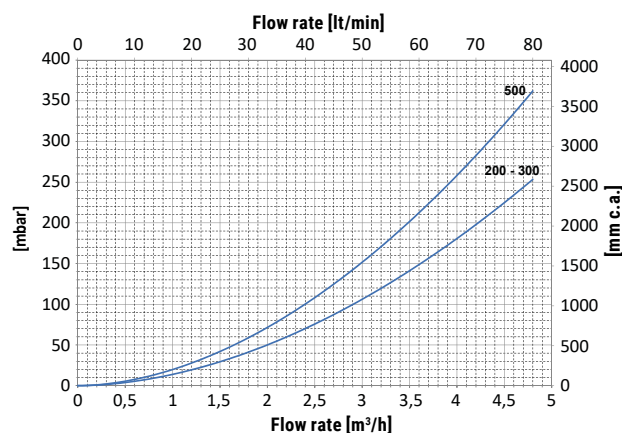


LOWER


Heat exchangers surface [m²]	
200	1,4
300	1,4
500	2,2



Heat Exchanger output referred to temperature and flow rate of primary circuit and with secondary at 10/45°C at maximum withdrawal of producible DHW (Upper limit of the curves referred to maximum primary flow rate in the heat exchanger, while the lower limit in the curves refer to the minimum primary flow rate)

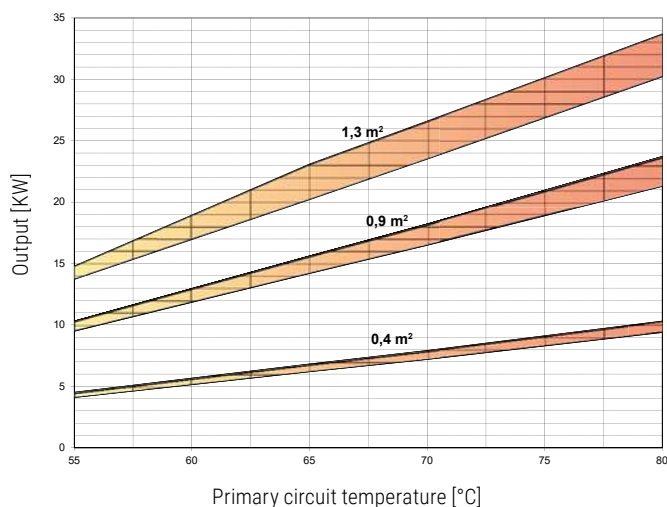


Heat exchanger surface	0,4 m ²		0,9 m ²		1,3 m ²	
	MAX	MIN	MAX	MIN	MAX	MIN
Flow rate [m ³ /h]	2	1	3	1,5	3,5	1,75

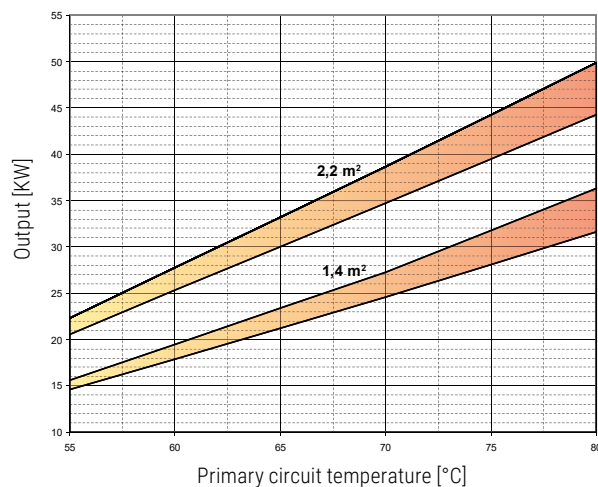

Heat exchanger surface	1,4 m ²		2,2 m ²	
	MAX	MIN	MAX	MIN
Flow rate [m ³ /h]	3	1,5	3,5	1,75



EXAMPLE OF INSTALLATION WITH BOLLY® 2 AP

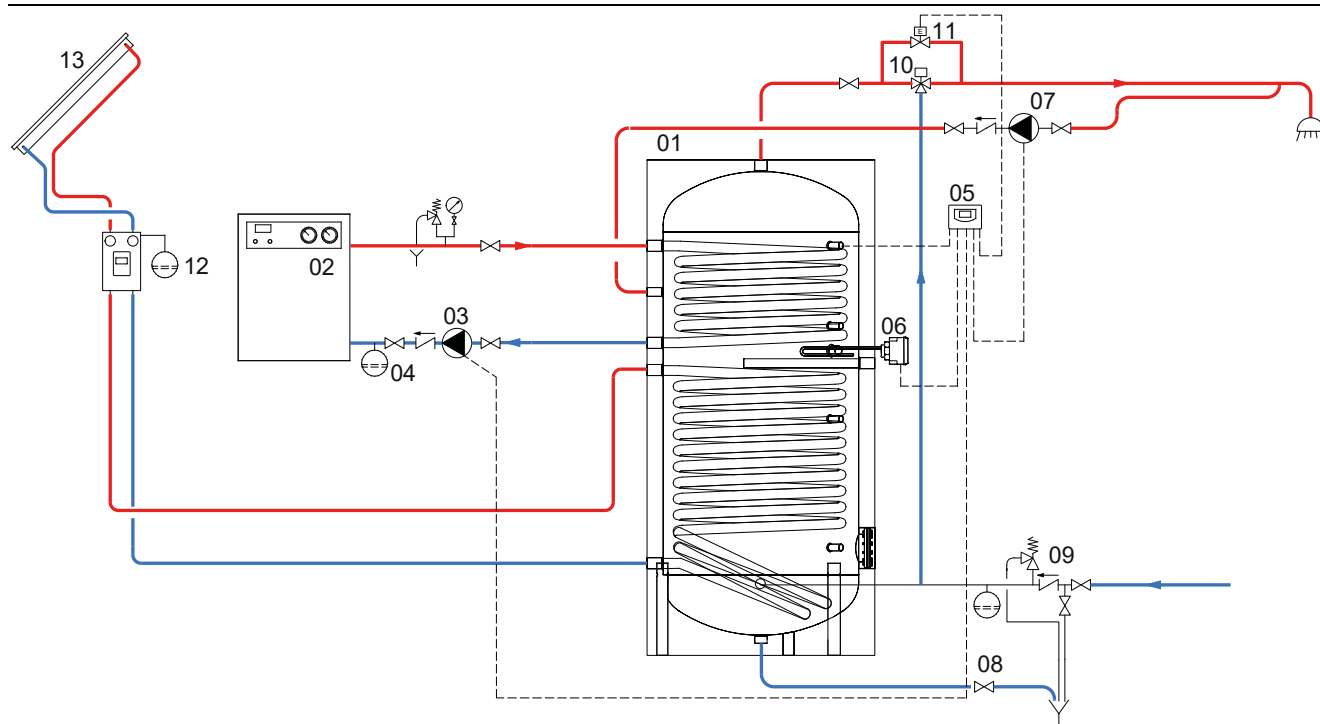

1 BOLLY® 2 AP	5 Electronic control /thermostat	9 Hydraulic safety group	13 Solar panels
2 Generator	6 Electric immersion heater (optional)	10 Thermostatic mixing valve	
3 Circulation group	7 D.H.W. recirculation group	11 By-pass solenoid valve	
4 Expansion vessel	8 Blowdown valve	12 Solar system circulation group	

The following schemes are purely illustrative. To realize the installation, always refer to a qualified technician.